

Via-30P
Using External Sounder

-
1. Connect the Sounding devices to Terminal 3 (+) & Terminal 4 (-) of the control panel, observing polarity.
-

NOTE: 2A max. output @ 10.5-13.8VDC

Sounder (Bell) Connections

1. Make sounder connections to alarm output terminals 3 (+) and 4 (-) on the control panel.

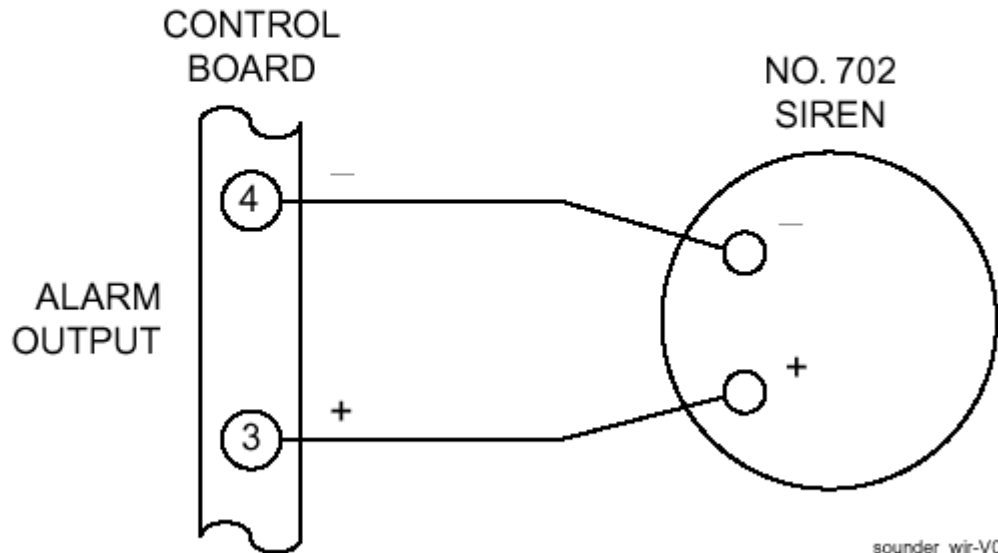


Figure 2-6. Typical Sounder Wiring